
Battery Module User Manual

Product name: Li-ion Battery Module

S52200

Version: P1.0

This manual describes the instructions for using the Single battery module (S52200). Please read this manual before installing the batteries and follow the instructions carefully during installation. If there is any confusion, please contact the manufacturer immediately for advice and clarification.

Catalogue

Chapter 1 Products 3

Chapter 2 Battery Module Safe Handling Guide9

Chapter 3 Product Installation Instructions 12

Chapter 4 Safety Precautions 14

Chapter 5 Troubleshooting15

Chapter 6 Emergencies 16

Chapter 1 Products

The Single battery module (S52200) is one of the new energy storage products that can be used to support reliable power for various devices and systems. It is especially suitable for high power, limited installation space, restricted load bearing and long cycle life application scenarios. S52200 has a built-in BMS battery management system that manages and monitors battery information including voltage, current and temperature. In addition, the BMS can balance the charge and discharge of the battery to extend the cycle life. Multiple batteries can be connected in parallel to expand capacity and power paralleling for greater capacity and longer power support time requirements.

1.1. Characteristic introduction


- Battery module using lithium iron phosphate cells, compared with the same size lead-acid battery weight reduced by 40%;
- The Single structure enables modules to be placed in a Single manner, easy and flexible to maintain, and highly versatile;
- Battery module housing with insulated painted metal sheet metal;
- High-power quick-plug connector for the power output input of the battery module, supporting hot-swapping;
- Battery modules can support up to 16 groups for parallel use, not for series use
- Low self-discharge of the battery module, no memory effect, more excellent performance of shallow charging and discharging;

1.2. Function Introduction

- ✓ ARM low-power processors;
- ✓ Use of professional battery management chips;
- ✓ Support for current-limited charging mode (up to 10A);
- ✓ Support for CAN/RS485 communication;
- ✓ Built-in 4-channel temperature acquisition;
- ✓ Support high and low temperature overcharge and overdischarge protection;
- ✓ Support for battery equalization functions;
- ✓ Support for SOC calculation and calibration;

- ✓ Support two levels of overcurrent protection;
- ✓ Support for output short-circuit protection;
- ✓ Support for reverse polarity protection;
- ✓ Multiple automatic fault detection (sampling, MOS, battery failure)


1.3. Specification parameters

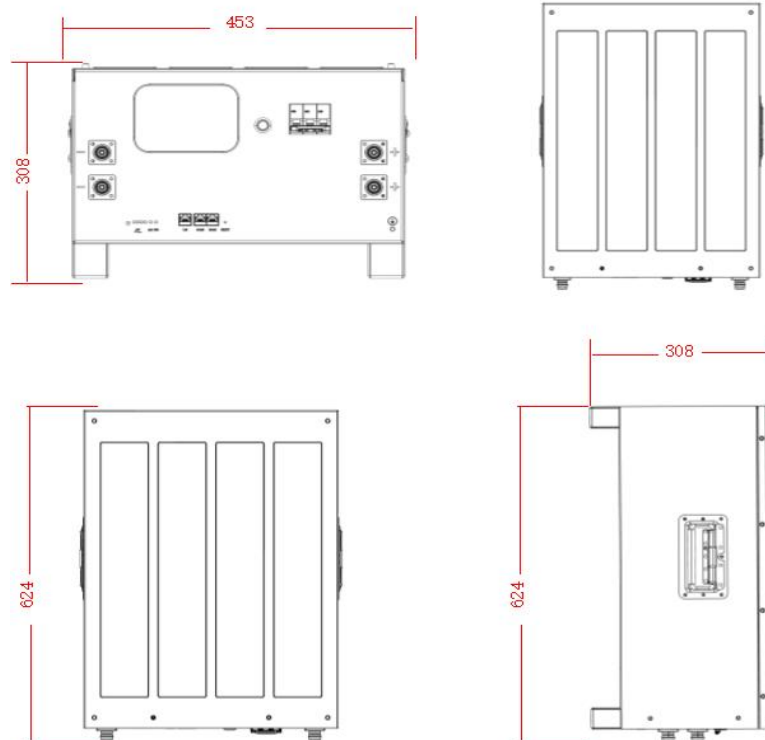

Battery module size diagram

Product Model	S52200
Battery voltage rating	51.2V
Operating voltage range	44.8V to 58.4V
Support floating charge voltage	55V±1V
Battery Capacity	200Ah
Battery power	10.24KWh
Internal resistance	≤50mΩ
Rated discharge current/maximum allowable discharge current	100A/200A
Rated charging current/maximum allowable charging current	100A/200A
Battery operating ambient temperature range	Charge 0℃～+55℃ Discharge -10℃～+50℃
Recommended working environment temperature	+10℃～+30℃
Storage temperature specification	0-25℃/12 months
Battery module size (W*D*H mm)	Bare machine: 600×440×300mm
Weight	85±1KG
Housing	Metal housing with insulation coating
Cooling method	Natural cooling
Display method	Display
Communication method	CAN/RS485

1.4. Interface Definition

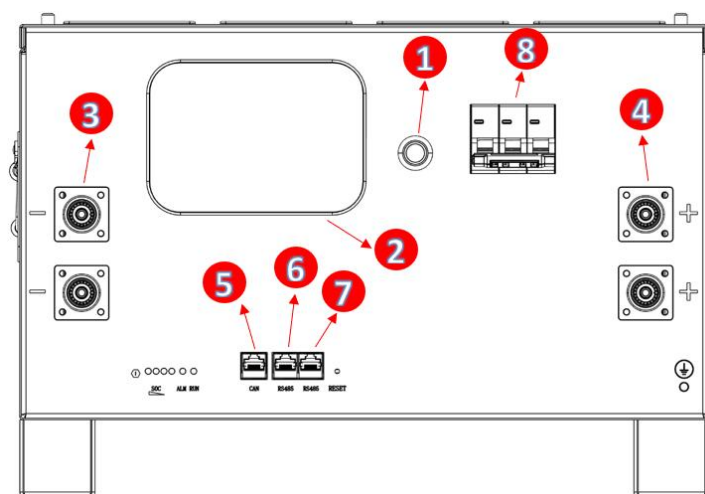

①	Start button	⑤	CAN/RS485 interface
②	Touch screen	⑥	RS485 interface
③	Output negative	⑦	RS485 interface
④	Output positive	⑧	Circuit breaker

Screen

Display: Display the parameters of the battery module.

(1) Main menu page

After power-up/sleep activation, the BMS internal data will be displayed, as shown below:


You can click the icon below to switch pages.



(2) Status monitoring page

After clicking STATUS, the page appears as follows:


You can go back to the main page by clicking on the top right corner.

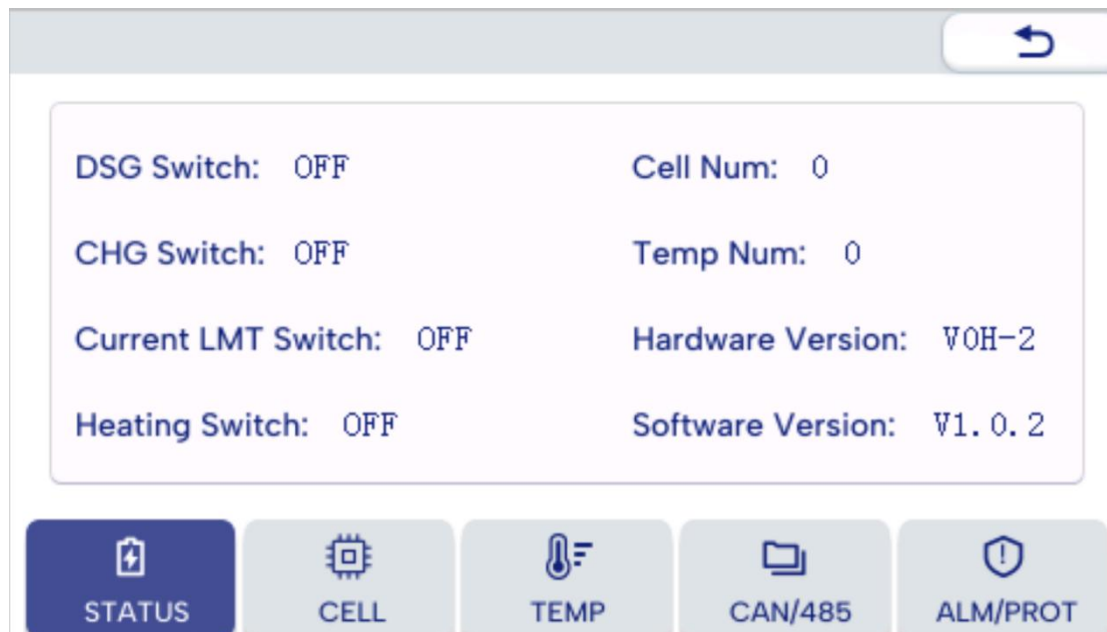

(3) Battery parameter acquisition page

After clicking on the CELL, it will enter the "Battery Parameter Acquisition" page, as shown in the following figure:

You can go back to the main page by clicking on the top right corner.

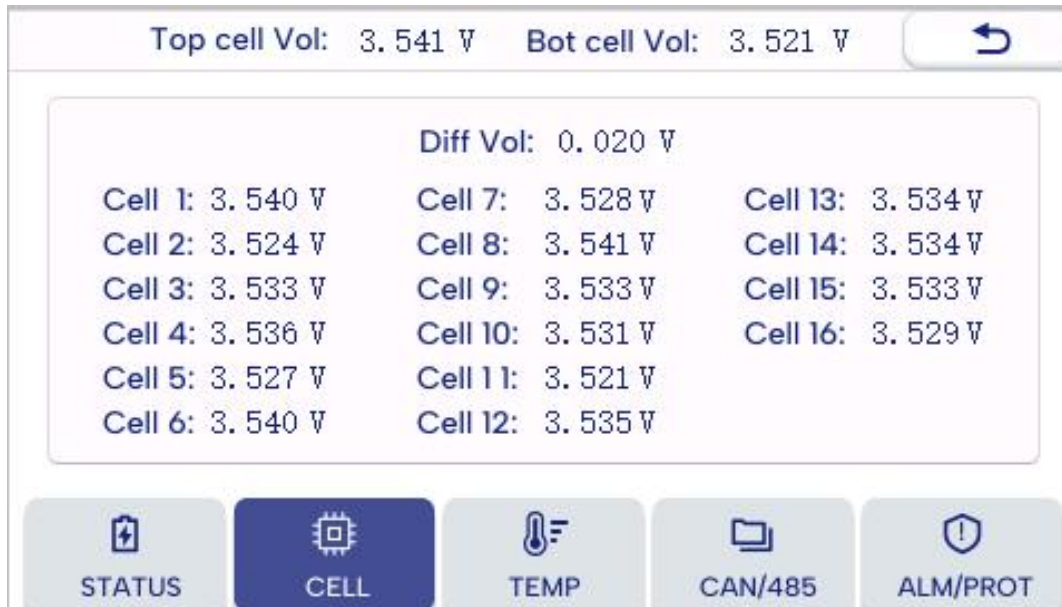

(4) Temperature monitoring page

Click TEMP to enter the temperature monitoring page, the display screen is as follows:



(5)Communication selection page


Click CAN/485 to enter the communication selection page, the display screen is as follows:

Remarks: The page is mainly for CAN selection.485 communication adopts automatic self-adaption which users don't need to select.



(6) Alarm information page

Click ALM/PROT to enter the alarm information monitoring page, the screen is displayed as follows:

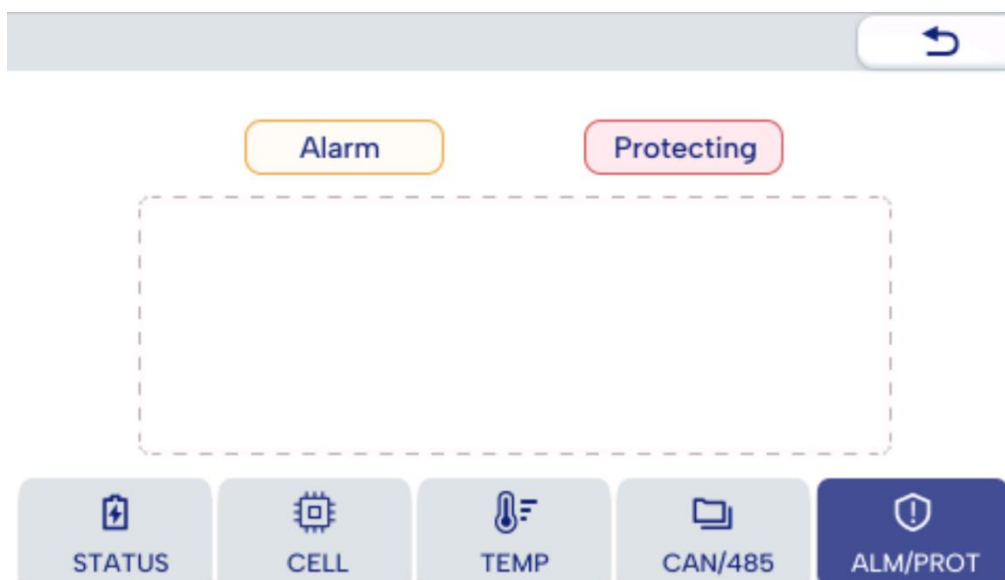

RS485/CAN interface

RS485/CAN communication interface: (RJ45 port) Communication according to RS485/CAN protocol.


CAN - using 8P8C vertical RJ45 socket			
RJ45 Pinout	Definition Description	RJ45 Pinout	Definition Description
1,8	RS485-B	4	CANH
2,7	RS485-A	5	CANL
3	GND	6	GND

RS485/CAN interface definition

RS485 interface

RS485 communication interface: (RJ45 port) communicate according to RS485 protocol, read battery information, also can be used for multiple groups of lithium batteries for parallel communication.

RS485-using 8P8C vertical RJ45 socket		RS485-using 8P8C vertical RJ45 socket	
RJ45 Pinout	Definition Description	RJ45 Pinout	Definition Description
1,8	RS485-B1	9,16	RS485-B2
2,7	RS485-A1	10,15	RS485-A2
3,6	GND	11,14	GND
4,5	Internal communication	12,13	Internal communication




RS485 parallel communication interface definition

BMS Functionality

Protection and alarms	Management and monitoring
End of charge/discharge	Battery Balance
Charging overvoltage	Smart charging mode
Charge/discharge overcurrent	Charging current limit
High/low temperature	Calculation of capacity reservation
Short Circuit	Administrator Monitoring
Reverse power cord connection	Operation log

Chapter 2 Battery Module Safe Handling Guide

2.1. System topology diagram

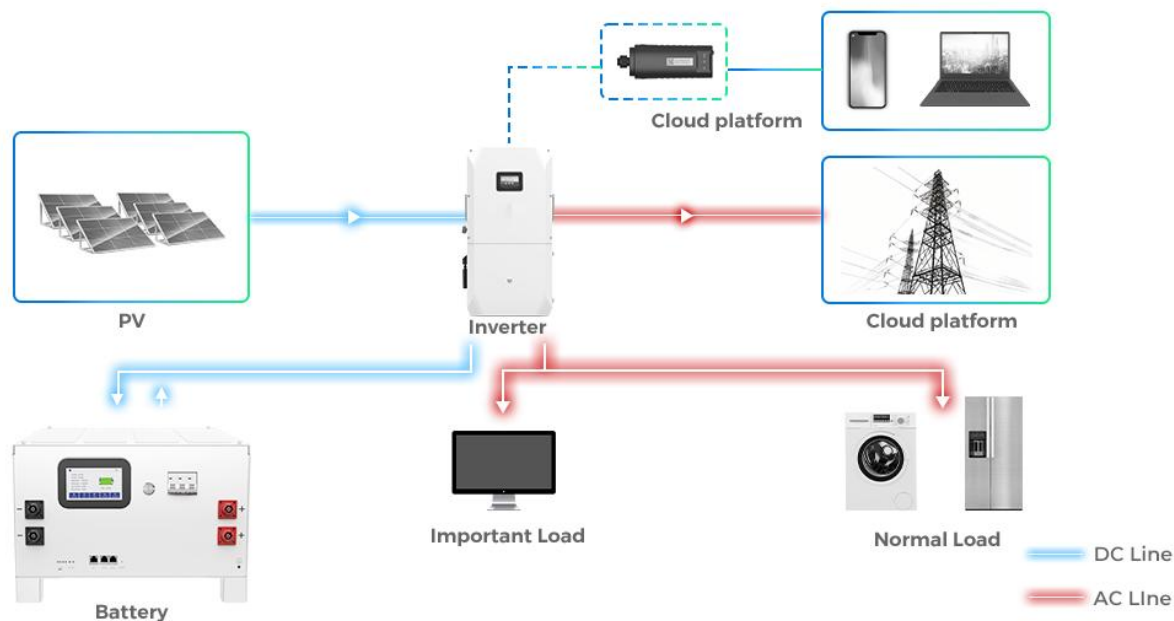

2.2. Marking

Rechargeable Li-ion Battery

Model: S52200

Date of manufacture

Rated capacity	200Ah
Total Energy	10.24KWh
Operating Voltage Range	44.8~58.4V
Max Discharge Current	200A
Efficiency	> 90%
Charging Temperature:	0°C ~ 55°C
Discharging Temperature:	-10°C ~ 50°C
IP Rating:	IP54
Nominal Voltage	51.2Vd.c.

Battery designation as specified in IFpP54/174/205/[16S]M/-10+50/95



CAUTION

Do not disconnect, disassemble or repair by yourself

Do not drop. Deform, impact, cut or spearing with a sharp object.

Do not place near open flame or incinerate

Do not sit or put heavy thing on battery

Keep away from moisture or liquid

Keep out of reach of children, animals or insects

Emergency Situations

If leaking, fire, wet or damaged, switch off the breaker and do away from the Battery.


Do not touch the leaking liquid. Do not use water. Sand or dry power extinguisher is usable

2.3. Tools


To install the battery pack, you may need these tools:



Phillips screwdriver



Cable Crimper



Voltmeter

NOTE: Use a properly insulated tool to prevent accidental electric shock or short circuit. If insulated tools are not available, cover the entire exposed metal surface of the available tools, except their tips, with insulating tape.

2.4. Security

It is recommended that the following safety equipment be worn when handling battery packs



Insulation gloves



Goggles



Safety shoes

2.5. Attachment List

Name	Specification	Quantity
Ground cable set	2.5mm ² *2m	1
Grounded parallel cable	2.5mm ² *0.4m	1
Communication cable	2m	1
Communication parallel cable	0.4m	1
Power cable	50mm ² *2m	2
Parallel cable	50mm ² *0.4m	2
User manual	S52200	1

Chapter 3 Product Installation Instructions


3.1. Connection Instructions

Note: For safe operation and regulatory compliance, a separate DC overcurrent protector or disconnect device is required for battery installation. In some applications, a disconnect device may not be required, but an overcurrent protection device is still required. Refer to the table below for typical amperage for the required fuse or breaker size.

Warning! All wiring must be done by qualified personnel.

Warning! Using the proper cables for battery connections is important for safe and efficient system operation. To reduce the risk of injury, use the appropriate recommended cable and terminal sizes below.

Recommended battery cable and terminal sizes.

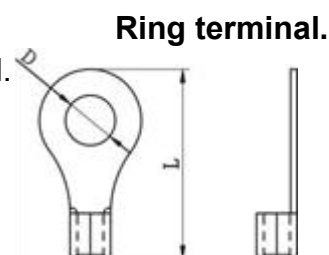

Battery Capacity	Cable Size	Ring terminals		
		Cable mm ²	Size	
			D (mm)	L(mm)
200Ah	1/0AWG	50	8.4	33.5

3.2. Installation conditions

Please ensure that the installation location meets the following conditions:

- The area is completely waterproof.
- The floor is flat.
- No flammable and explosive materials.
- The ambient temperature is within the range of 0°C to 55°C.
- Temperature and humidity are maintained at a stable level.
- There is very little dust and dirt in the area.

3.3. Installation Instructions

Caution




If the ambient temperature is outside the operating range, the battery pack will stop working to protect itself. The optimal temperature range for battery pack operation is 0°C to 50°C. Frequent exposure to harsh temperatures may degrade the performance and life of the battery pack.

A. Single battery module installation

1. Place the first battery module steadily on the flat surface
2. Connect the ground cable of the battery module
3. Communication cable for connecting battery module
4. Connect the cable to the inverter

The battery module is placed on a flat surface

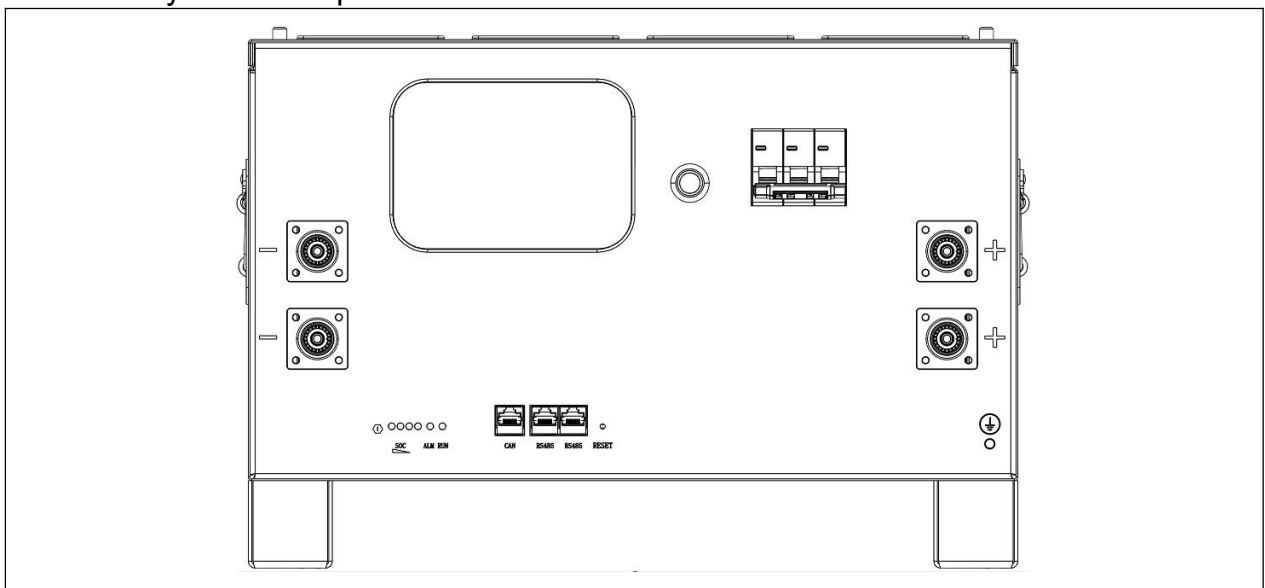

B. Parallel installation

1. The first battery module is placed on the plane
2. Accurately place the bottom installation holes of the second battery module in the four positioning columns on the upper cover of the first battery module
3. Connect the ground cable between the battery modules
4. Connect the communication cable between the battery modules
5. Connect the cables between the battery modules
6. Connect the cable to the Inverter

3.4. Power on instructions


(1) Turn on the power

Double-check all power and communication cables.

Turn on all battery modules and confirm that the data on the display screen is shown normally.

(2) Parallel mode connection

Normal parallel mode, as shown in the following figure

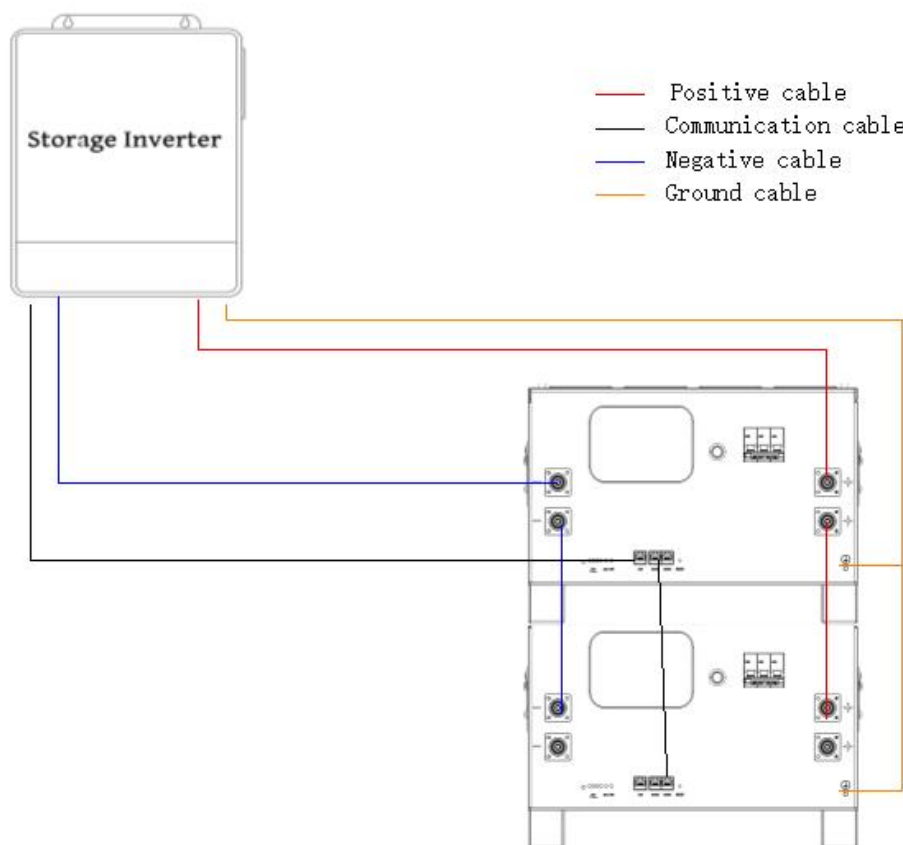

Note: If all battery displays are on, this means that the battery system is good and working properly.

Chapter 4 Safety Precautions

Warning

4.1. Precautions before installation

- 1) After opening the box, please check the product and packing list first, if the product is damaged or missing parts, please contact your local retailer;
- (2) Before installation, be sure to cut off the power to the grid and ensure that the battery is in the off state;
- 3) Wiring must be correct, do not make mistakes with positive and negative cables, and ensure that there is no short circuit with external equipment;
- (4) prohibit the direct connection of batteries and AC power;
- 5) the embedded BMS in the battery is designed for 48VDC, please do not connect the battery in series;
- 6) the battery system must be well grounded and its resistance must be less than 1Ω;
- 7) Please ensure that the electrical parameters of the battery system are compatible with the relevant equipment;
- 8) Keep the battery away from water and fire.

4.2. Precautions for the use process

- 1) If the battery system needs to be moved or repaired, the power must be disconnected and the battery completely shut down;

-
- 2) It is strictly forbidden to connect the battery with different types of batteries.
 - 3) It is strictly forbidden to work the battery with faulty or incompatible inverters;
 - 4) Battery disassemble is strictly prohibited (QC tags are removed or damaged);
 - 5) In the event of a fire, only dry powder fire extinguishers may be used, and the use of liquid fire extinguishers is prohibited;
 - 6) Do not open, repair or disassemble the battery except by personnel authorized by the manufacturer or distributor. We assume no responsibility for any consequences or liability associated with violations of safe practices or violations of design, manufacturing and equipment safety standards.



Reminder

- 1) Please read the user manual (in the attachment) carefully;
- (2) If the battery is stored for a long time, it needs to be charged every six months, and the SOC should be no less than 80%;s
- 3) The battery needs to be recharged within 12 hours after it has been completely discharged;
- 4) Do not expose cables to the elements;
- 5) All battery terminals must be disconnected for maintenance purposes;
- 6) If there is any abnormality, please contact the supplier within 24 hours.
- 7) Direct or indirect damages caused by the above items are not covered by the warranty.

Chapter 5 Troubleshooting

5.1. Troubleshooting steps

- 1) Whether the battery can be turned on;
- 2) If the battery is on, please check the alarm interface on the display screen to see if there is any alarm information;
- 3) If there is no alarm message, please check whether the battery can be charged or discharged.

5.2. Fault Identification

The battery cannot be turned on, and none of the lights light up or flicker after the power is turned on.

If the external battery switch is on, the status light is flashing, the external power supply voltage is 48V or more, and the battery still does not turn on, please contact your dealer.

The battery can be turned on, but the red light is on and cannot be charged or discharged. If the red light is on, the system is not working properly, please check the following values:

Temperature: Above 56°C or below -20°C, the battery cannot work.

Solution: Move the battery to a normal operating temperature range of -10°C to 50°C.

Current: If the current is greater than 200A, the battery protection will open.

Solution: Check if the current is too high, if it is, change the setting on the power side.

High voltage: If the charging voltage exceeds 57.6V, the battery protection will turn on.

Solution: Check if the voltage is too high, if so, change the setting on the power side.

Low Voltage: When the battery is discharged to 44.8V or lower, the battery protection

will be turned on. Solution: Charge the battery for a period of time, and the red light will turn off.

In addition to the above four points, if you still can not find the fault, please turn off the battery and repair.

5.3. Charging Troubleshooting

1) Cannot be charged:

Disconnect the power cord, measure the voltage on the power side, if the voltage is 53~54V, restart the battery, connect the power cord and try again, if it still doesn't work, turn off the battery and contact the dealer.

2) Unable to discharge:

Disconnect the power cord and measure the voltage on the battery side, if it is lower than 44.8V, please charge the battery; if the voltage is higher than 48V and still cannot be discharged, please turn off the battery and contact your dealer.

Chapter 6 Emergencies

6.1. Battery leakage

If the battery pack leaks electrolyte, avoid contact with the leaking liquid or gas. In case of contact with the leaking substance, the following measures should be taken immediately.

Inhalation: Evacuate the contaminated area and seek medical attention.

Contact with eyes: Flush eyes with running water for 15 minutes and seek medical attention. Contact with skin: Wash affected area thoroughly with soap and water and seek medical attention.

Ingestion: Induce vomiting and seek medical attention.

6.2. Fire

Do not use water! Use only dry powder extinguishers; if possible, move the battery pack to a safe area before it catches fire.

6.3. Immersion

If the battery pack gets wet or submerged in water, do not let anyone touch it, then contact the manufacturer or an authorized distributor for technical support.

6.4. Battery damage

Damaged batteries are dangerous and must be handled with the utmost care. They are unfit for use and may pose a danger to persons or property. If a battery pack appears to be damaged, pack it in its original container and return it to the manufacturer or authorized distributor.